


CMU OPENING REINF SCHEDULE						
8" WALLS						
W	LINTEL DEPTH	STIRRUP SIZE, SPG	"A" BARS	"B" BARS	"C" BARS	JAMB WIDTH
≤ 2'-8"	8"	-	1	1	1	8"
>2'-8" ≤ 4'-0"	16"	-	2	1	1	8"
>4'-0" ≤ 6'-0"	24"	#3@8"	2	1	2	16"
>6'-0" ≤ 8'-0"	32"	#3@16"	2	2	3	24"
>8'-0" ≤ 10'-0"	48"	#3@24"	2	2	3	24"
12" WALLS						
W	LINTEL DEPTH	STIRRUP SIZE, SPG	"A" BARS	"B" BARS	"C" BARS	JAMB WIDTH
≤ 2'-8"	8"	-	2	2	2	8"
>2'-8" ≤ 4'-0"	16"	-	2	2	2	8"
>4'-0" ≤ 6'-0"	24"	#3@8"	2	2	4	16"
>6'-0" ≤ 8'-0"	32"	#3@16"	2	2	6	24"
>8'-0" ≤ 10'-0"	48"	#3@24"	2	2	6	24"
>10'-0" ≤ 16'-0"	56"	#3@24"	4	2	6	24"

**NOTES:**

- USE THE SAME BAR SIZES USED FOR THE TYPICAL WALL REINFORCING AS SHOWN ON THE DRAWINGS.
- EXTEND "C" BARS 48 BAR DIAMETERS OR 2'-0" MINIMUM BEYOND TOP AND BOTTOM OF OPENING EXCEPT THAT WHEN "H" OR "W" EXCEEDS 2'-0", "C" BARS SHALL EXTEND FULL HEIGHT. WHERE THERE IS LESS THAN 8'-0" BETWEEN ADJACENT OPENINGS, EXTEND REINFORCING CONTINUOUS TO 2'-8" BEYOND FURTHEST OPENING.
- "A" AND "B" BARS SHALL EXTEND 48 BAR DIAMETERS OR 2'-0" MINIMUM EACH SIDE OF THE OPENINGS.
- FOR BAR SIZES, MATCH TYPICAL WALL REINFORCING AS SHOWN ON THE BUILDING WALL SECTIONS.

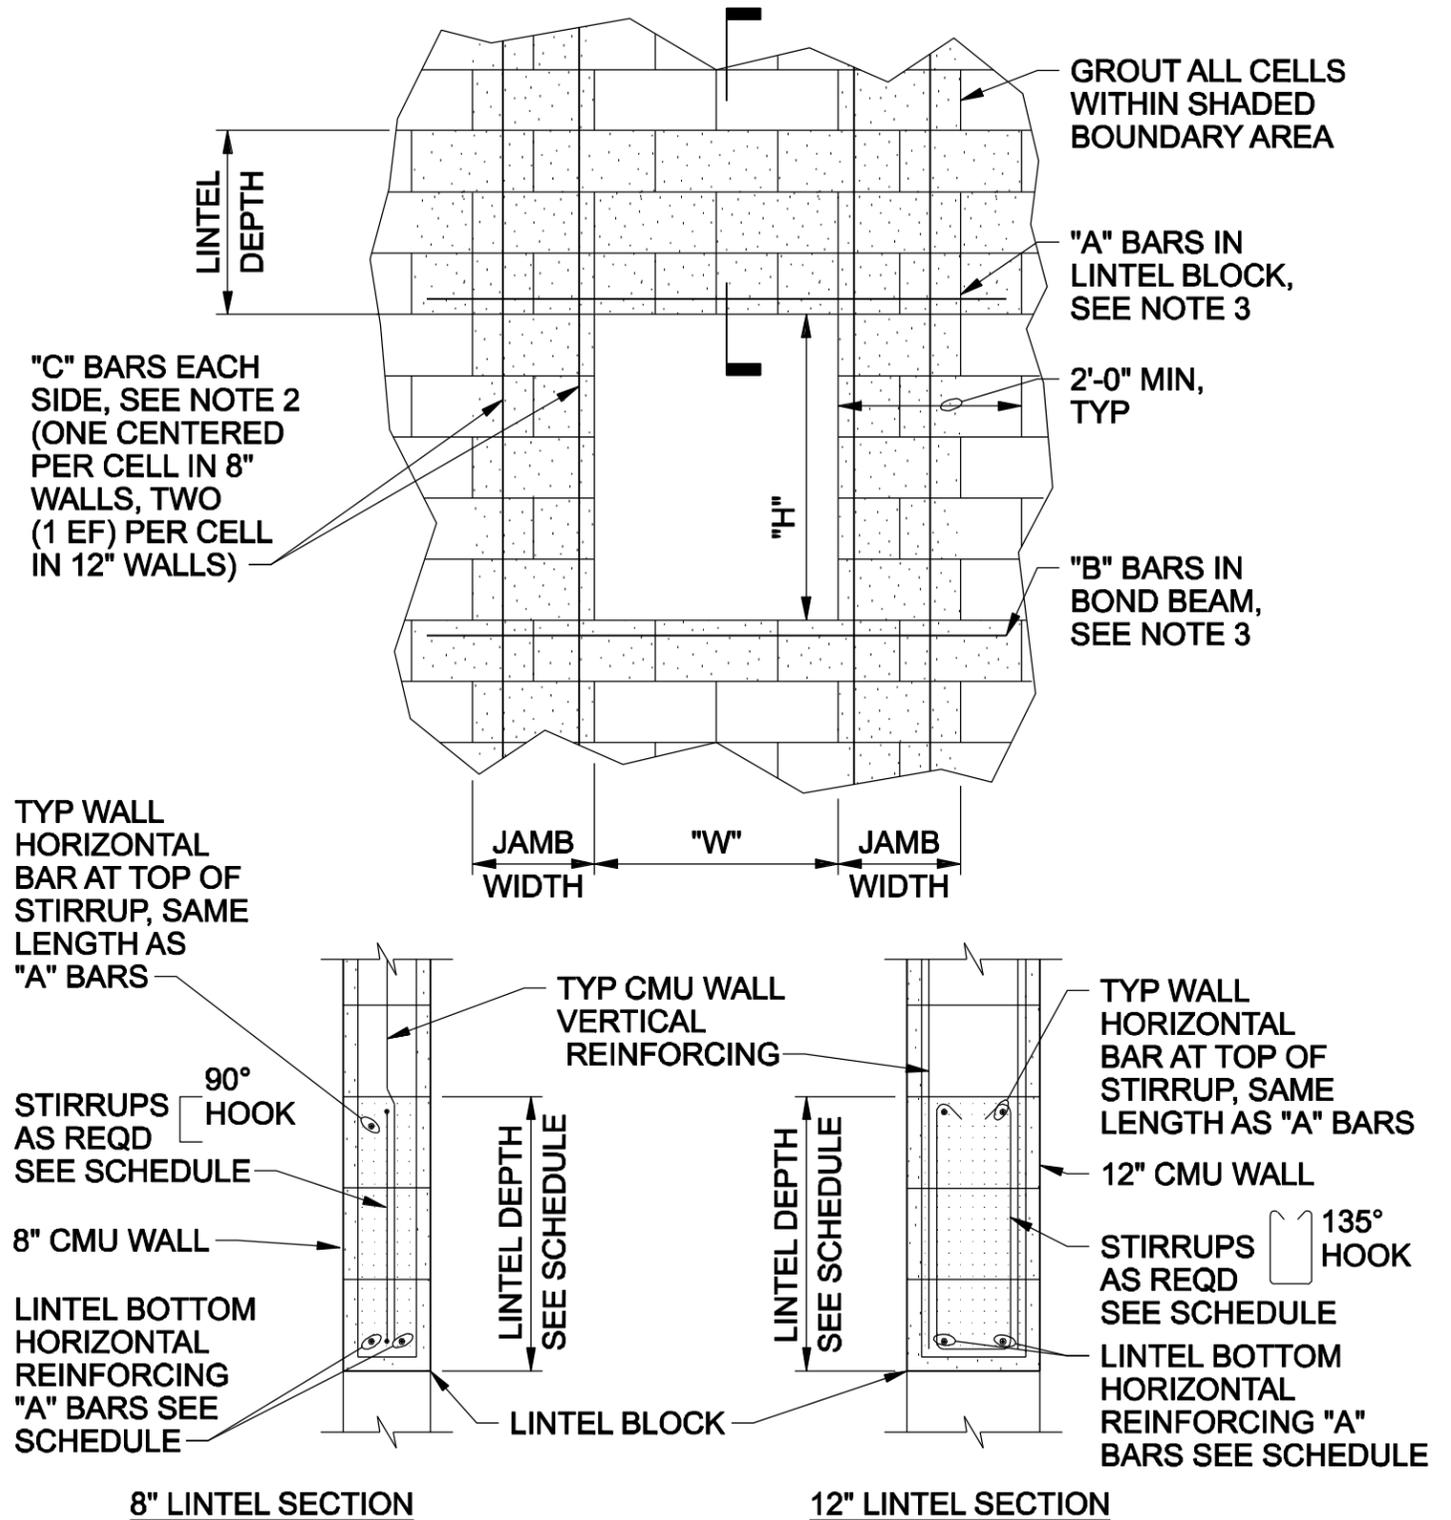

**CMU OPENING REINFORCING**

NTS